

TET3200-12-069xA

AC-DC / HVDC Front-End Power Supplies

The TET3200 Series is a 3200 Watt AC-DC power-factor-corrected (PFC) or DC/DC power supply that converts standard AC mains power or high voltage DC bus voltages into a main output of 12 VDC for powering intermediate bus architectures (IBA) in high performance and reliability servers, routers, and network switches.

The TET3200-12-069xA meets international safety standards and displays the CE-Mark for the European Low Voltage Directive (LVD).

Key Features & Benefits

- Best-in-class, Titanium efficiency
- Universal input voltage range: 90 - 300 VAC
- AC input with power factor correction
- DC input voltage range: 180 - 410 VDC
- Hot-plug capable
- Parallel operation with active current sharing thru analog bus
- Full digital controls for improved performance
- High density design: 33.8 W/in³
- Small form factor: 555 x 69 x 40.5 mm (21.85 x 2.72 x 1.60 in)
- I2C communication interface with Power Management Bus protocol for monitoring, control, and firmware update via bootloader
- Overtemperature, output overvoltage and overcurrent protection
- RoHS Compliant
- 2 Status LEDs: AC OK and DC OK with fault signaling
- Safety approved to UL/CSA 62368-1, IEC/EN 62368-1

Applications

- High Performance Servers
- Routers
- Networking Switches



befuse.com/power-solutions

1. ORDERING INFORMATION

| TET | 3200 | - | 12 | - | 069 | x | A | Option Code |
|----------------|-------------|------|-----------|------|-------|---------------------------------------|-------|--------------------------|
| Product Family | Power Level | Dash | V1 Output | Dash | Width | Airflow | Input | |
| TET Front-End | 3200 W | | 12 V | | 69 mm | N: Normal R: Reverse ¹⁾ | A: AC | Blank: Standard model |

¹⁾ Front to Rear

2. OVERVIEW

The TET3200-12-069RA is a fully DSP controlled, highly efficient front-end power supply. It incorporates resonant-soft-switching technology and interleaved power trains to reduce component stresses, providing increased system reliability and very high efficiency. With a wide input operating voltage range and minimal linear derating of output power with respect to ambient temperature, the TET3200-12-069RA maximizes power availability in demanding server, switch, and router applications. The power supply is fan cooled and ideally suited for server integration with a matching airflow path.

The PFC stage is digitally controlled using a state-of-the-art digital signal processing algorithm to guarantee best efficiency and unity power factor over a wide operating range.

The DC-DC stage uses soft switching resonant techniques in conjunction with synchronous rectification. An active OR-ing device on the output ensures no reverse load current and renders the supply ideally suited for operation in redundant power systems. The always-on +12V standby output provides power to external power distribution and management controllers. Its protection with an active OR-ing device provides for maximum reliability.

Status information is provided with front-panel LEDs. In addition, the power supply can be monitored and controlled (i.e. fan speed setpoint) via I2C communication interface with Power Management Bus protocol. It allows full monitoring of the supply, including input and output voltage, current, power, and inside temperatures. The same I2C bus supports the bootloader to allow field update of the firmware in the DSP controllers.

Cooling is managed by a fan, controlled by the DSP controller. The fan speed is adjusted automatically depending on the actual power demand and supply temperature and can be overridden through the I2C buses.

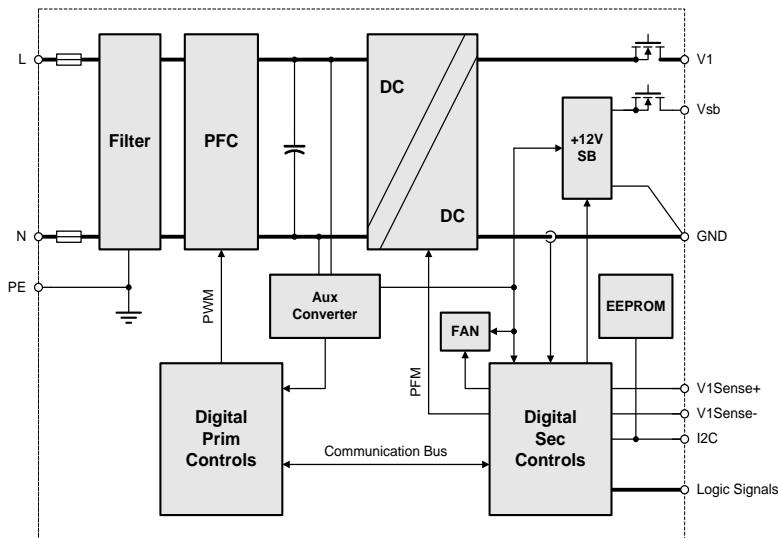


Figure 1. TET3200-12-069RA Block Diagram

3. ABSOLUTE MAXIMUM RATINGS

Stresses in excess of the absolute maximum ratings may cause performance degradation, adversely affect long-term reliability and cause permanent damage to the supply.

| PARAMETER | CONDITIONS / DESCRIPTION | MIN | MAX | UNITS |
|-------------|--------------------------|------------|-----|-------|
| $V_{i\max}$ | Maximum Input | Continuous | 300 | VAC |



tech.support@psbel.com
belfuse.com/power-solutions

4. INPUT

General Condition: $T_A = 0 \dots +50^\circ\text{C}$, unless otherwise noted.

| PARAMETER | DESCRIPTION / CONDITION | MIN | NOM | MAX | UNIT |
|------------------|----------------------------------------|--------------------------------------------------------------------------------------------------------|-------|-------|------------------|
| $V_{i\ nom}$ | AC Nominal Input Voltage | 100 | 230 | 277 | VAC |
| V_i | AC Input Voltage Ranges | Normal operating ($V_{i\ min}$ to $V_{i\ max}$) | 90 | 300 | VAC |
| $V_{i\ nom\ DC}$ | DC Nominal Input Voltage ²⁾ | 240 | 380 | 380 | VDC |
| $V_{i\ DC}$ | DC Input Voltage Ranges | Normal operating ($V_{i\ min}$ to $V_{i\ max}$) | 180 | 410 | VDC |
| $V_{i\ derated}$ | Derated Input Voltage Range | See Figure 20 and Figure 33 | 90 | 180 | VAC |
| $I_{i\ max}$ | Max Input Current | $V > 200$ VAC, > 100 VAC | | 17 | A _{rms} |
| $I_{i\ p}$ | Inrush Current Limitation | $V_{i\ min}$ to $V_{i\ max}$, $T_{NTC} = 25^\circ\text{C}$ (Figure 5) | | 35 | A _p |
| F_i | Input Frequency | | 47 | 50/60 | Hz |
| PF | Power Factor | $V_{i\ nom}$, 50Hz, $> 0.2 I_{i\ nom}$ | 0.96 | 0.99 | W/VA |
| $V_{i\ on}$ | Turn-on Input Voltage ³⁾ | Ramping up | 80 | 87 | VAC |
| $V_{i\ off}$ | Turn-off Input Voltage ³⁾ | Ramping down | 75 | 85 | VAC |
| η | Efficiency Without Fan | $V = 230$ VAC, $0.1 \cdot k_{\text{nom}}$, $V_{x\ nom}$, $T_A = 25^\circ\text{C}$ | 94.34 | | |
| | | $V = 230$ VAC, $0.2 \cdot k_{\text{nom}}$, $V_{x\ nom}$, $T_A = 25^\circ\text{C}$ | 95.41 | | |
| | | $V = 230$ VAC, $0.5 \cdot k_{\text{nom}}$, $V_{x\ nom}$, $T_A = 25^\circ\text{C}$ | 95.05 | | % |
| | | $V = 230$ VAC, k_{nom} , $V_{x\ nom}$, $T_A = 25^\circ\text{C}$ | 93.89 | | |
| T_{hold} | Hold-up Time | After last AC zero point, $V > 10.8\text{V}$, V_{SB} within regulation, $V = 230$ VAC, $P_{x\ nom}$ | 12 | 16 | ms |

²⁾ In HVDC input application, LIVE pin has to be connected to "+" and NEUTRAL has to be connected to "-", Otherwise PSU will have no output

³⁾ The Front-End is provided with a typical hysteresis of 3 V during turn-on and turn-off within the ranges.

4.1 INPUT FUSE

Quick-acting 25 A input fuses (7 x 32.7 in mm) in series with both the L- and N-line inside the power supply protect against severe defects. The fuses are not accessible from the outside and are therefore not serviceable parts.

4.2 INRUSH CURRENT

The AC-DC power supply exhibits an X-capacitance of only 4.3 μF , resulting in a low and short peak current, when the supply is connected to the mains. The internal bulk capacitor will be charged through an NTC which will limit the inrush current.

NOTE: Do not repeat plug-in / out operations below 5 sec interval time at maximum input, high temperature condition, or else the internal in-rush current limiting device (NTC) may not sufficiently cool down and excessive inrush current or component failure(s) may result.

4.3 INPUT UNDER-VOLTAGE

If the RMS value of input voltage (either AC or DC) stays below the input undervoltage lockout threshold V_{on} , the supply will be inhibited. Once the input voltage returns within the normal operating range, the supply will return to normal operation again.

4.4 POWER FACTOR CORRECTION

Power factor correction (PFC) (see Figure 4) is achieved by controlling the input current waveform synchronously with the input voltage. A fully digital controller is implemented giving outstanding PFC results over a wide input voltage and load ranges. The input current will follow the shape of the input voltage. If for instance the input voltage has a trapezoidal waveform, then the current will also show a trapezoidal waveform. At DC input voltage the PFC is still in operation, but the input current will be DC in this case.



| Asia-Pacific | Europe, Middle East | North America |
|-------------------|---------------------|-----------------|
| +86 755 298 85888 | +353 61 49 8941 | +1 866 513 2839 |

© 2023 Bel Power Solutions & Protection

BCD.20002_B

4.5 EFFICIENCY

The high efficiency (see *Figure 2*) is achieved by using state-of-the-art GaN power devices in conjunction with soft-transition topologies minimizing switching losses and a full digital control scheme. Synchronous rectifiers on the output reduce the losses in the high current output path. The rpm of the fan is digitally controlled to keep all components at an optimal operating temperature regardless of the ambient temperature and load conditions. *Figure 3* shows efficiency when input voltage is supplied from a high voltage DC source.

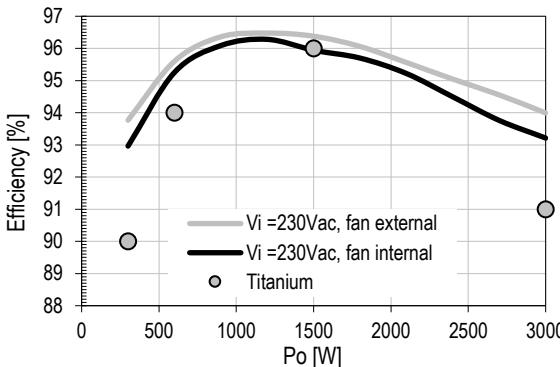


Figure 2. AC Input Efficiency vs. Load current

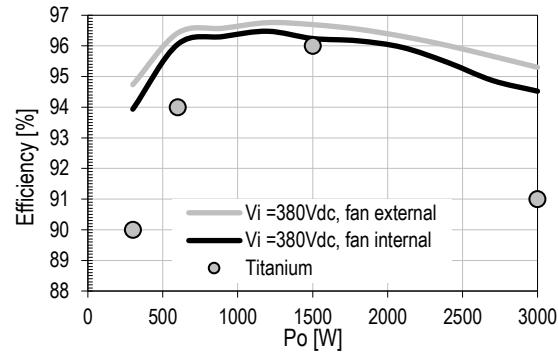


Figure 3. DC Input Efficiency vs. Load

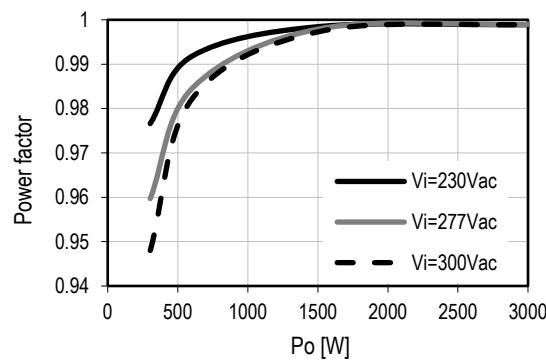


Figure 4. Power Factor vs. Load

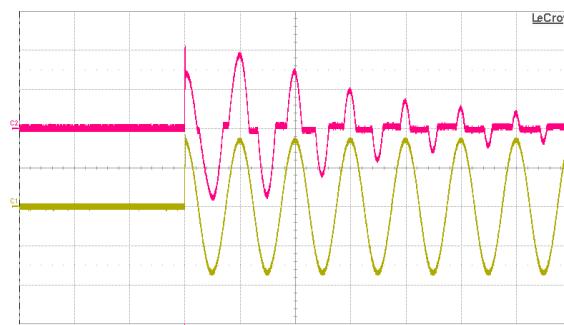


Figure 5. Inrush Current, $V_{in} = 300\text{Vac}$, 90° phase angle
CH1: V_{in} (250V/div), CH2: lin (10A/div), 20 ms/div

5. OUTPUT

General Condition: $T_A = 0 \dots +45^\circ\text{C}$, unless otherwise noted.

| PARAMETER | DESCRIPTION / CONDITION | MIN | NOM | MAX | UNIT |
|-------------------------------------------|------------------------------|----------------------------------------------------------------------------------------------------------------------------------------|------|--------|-----------------|
| Main Output V_1 | | | | | |
| $V_{1\ nom}$ | Nominal Output Voltage | | 12.3 | | VDC |
| $V_{1\ set}$ | Output Setpoint Accuracy | 0.5 $\cdot I_{\ nom}$, $T_{\ amb} = 25^\circ\text{C}$ | -0.5 | +0.5 | % $V_{1\ nom}$ |
| $dV_{1\ tot}$ | Total Regulation | V_1 min to V_1 max, 0 to 100% $I_{\ nom}$, T_a min to T_a max | -2 | +2 | % $V_{1\ nom}$ |
| $P_{1\ nomll}$ | Nominal Output Power | $V_1 = 12.3$ VDC, $V_{\ in} < 180$ VAC | | | W |
| $I_{1\ nomll}$ | Nominal Output Current | $V_1 = 12.3$ VDC, $V_{\ in} < 180$ VAC | | | A |
| $P_{1\ nom}$ | Nominal Output Power | $V_1 = 12.3$ VDC, $V_{\ in} > 180$ VAC | 3200 | | W |
| $I_{1\ nom}$ | Nominal Output Current | $V_1 = 12.3$ VDC, $V_{\ in} > 180$ VAC | 260 | | A |
| $I_{1\ ol}$ | Short Time Over Load Current | $V_1 = 12.3$ VDC, $V_{\ in} > 180$ VAC T_a min to T_a max, maximum duration 20 ms (See Section 5.2) | | 292 | A |
| $V_{1\ pp}$ | Output Ripple Voltage | V_1 nom, $I_{\ nom}$, 20MHz BW (See Section 5.1) | 70 | 120 | mVpp |
| $dV_{1\ Load}$ | Load Regulation | $V_1 = V_{1\ nom}$, 0 - 100 % $I_{\ nom}$ | 180 | | mV |
| $dV_{1\ Line}$ | Line Regulation | $V_1 = V_1$ min... V_1 max | 0 | | mV |
| $dI_{\ share}$ | Current Sharing | $(I_x - I_y) / I_{\ tot}$, $I > 25\% I_{\ nom}$ | -5 | +5 | % |
| dV_{dyn} | Dynamic Load Regulation | $\Delta I = 50\% I_{\ nom}$, $I = 5 \dots 100\% I_{\ nom}$, $dI/dt = 1$ A/ μ s, recovery within 1% of V_1 nom | -0.6 | 0.6 | V |
| T_{rec} | Recovery Time | | 0.5 | 1 | ms |
| $t_{AC\ V1}$ | Start-up Time from AC | $V_1 = 10.8$ VDC (see Figure 7) | 2.7 | 3 | sec |
| $t_{V1\ rise}$ | Rise Time | $V_1 = 10 \dots 90\% V_{1\ nom}$ (see Figure 8) | 20 | | ms |
| C_{Load} | Capacitive Loading | $T_a = 25^\circ\text{C}$ | | 30,000 | μ F |
| Standby Output V_{SB} | | | | | |
| $V_{SB\ nom}$ | Nominal Output Voltage | | 12 | | VDC |
| $V_{SB\ set}$ | Output Setpoint Accuracy | 0.5 $\cdot I_{SB\ nom}$, $T_{amb} = 25^\circ\text{C}$ | -1 | +1 | % $V_{SB\ nom}$ |
| $dV_{SB\ tot}$ | Total Regulation | V_1 min to V_1 max, 0 to 100% $I_{SB\ nom}$, T_a min to T_a max | -3 | +3 | % $V_{SB\ nom}$ |
| $P_{SB\ nom}$ | Nominal Output Power | $V_{SB} = 12$ VDC | 36 | | W |
| $I_{SB\ nom}$ | Nominal Output Current | $V_{SB} = 12$ VDC | 3 | | A |
| $V_{SB\ pp}$ | Output Ripple Voltage | $V_{SB\ nom}$, $I_{SB\ nom}$, 20 MHz BW (See Section 5.1) | 60 | 120 | mVpp |
| dV_{SB} | Droop | 0 - 100 % $I_{SB\ nom}$ | 200 | | mV |
| dV_{SBdyn} | Dynamic Load Regulation | $\Delta I_{SB} = 50\% I_{SB\ nom}$, $I_{SB} = 5 \dots 100\% I_{SB\ nom}$, $dI/dt = 1$ A/ μ s, recovery within 1% of V_1 nom | -0.6 | 0.6 | V |
| T_{rec} | Recovery Time | | 0.5 | | ms |
| $t_{AC\ VSB}$ | Start-up Time from AC | $V_{SB} = 90\% V_{SB\ nom}$ (see Figure 7) | 2.5 | 3 | sec |
| $t_{VSB\ rise}$ | Rise Time | $V_{SB} = 10 \dots 90\% V_{SB\ nom}$ (see Figure 9) | 20 | | ms |
| C_{Load} | Capacitive Loading | $T_{amb} = 25^\circ\text{C}$ | | 1,500 | μ F |



5.1 OUTPUT VOLTAGE RIPPLE

Ripple and noise shall be measured using the following methods:

- Outputs bypassed at the point of measurement with a parallel combination of 10 μ F tantalum capacitor in parallel with 0.1 μ F ceramic capacitors, referring the setup in *Figure 6*.
- The ripple voltage is measured with 20 MHz BWL.

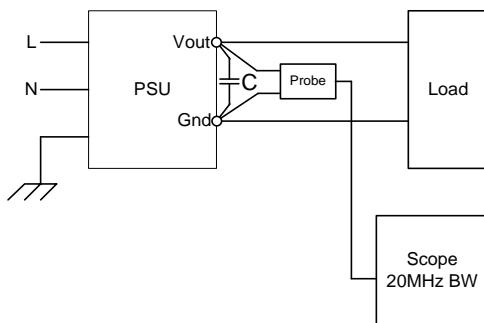


Figure 6. Output Ripple Test Setup

5.2 SHORT TIME OVERLOAD

The main output has the capability to allow output power up to 3600 W for a maximum duration of 20ms. This allows the system to consume extended power for short time dynamic processes.

5.3 OUTPUT ISOLATION

Main and standby output and all signals are isolated from the chassis and protective earth connection, although the applied voltage must not exceed 100 Vpeak to prevent any damage of the supply.

In order to prevent any potential difference in outputs or signals within the application these 3 grounds must be directly interconnected at system level. See also section 14 for pins to be interconnected.

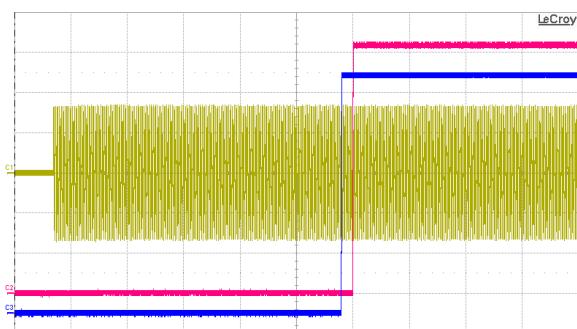


Figure 7. Turn-On AC Line 230 VAC, full load (500 ms/div)
CH1: Vin (200V/div); CH2: V1 (2V/div); CH3: VSB (2V/div)

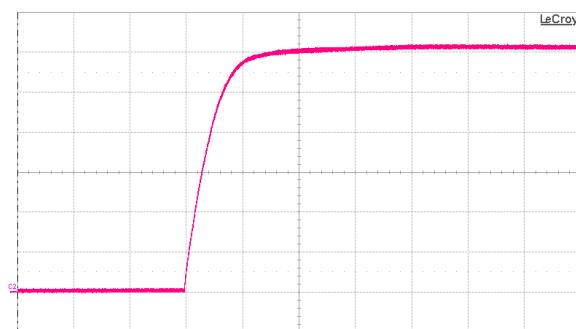


Figure 8. Turn-On AC Line 230 VAC, full load (1 ms/div)
CH2: V1 (2 V/div)



tech.support@psbel.com
belfuse.com/power-solutions

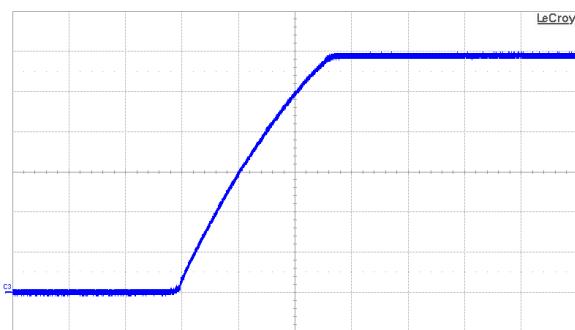


Figure 9. On AC Line 230 VAC, full load (2 ms/div)
CH3: VSB (2 V/div)

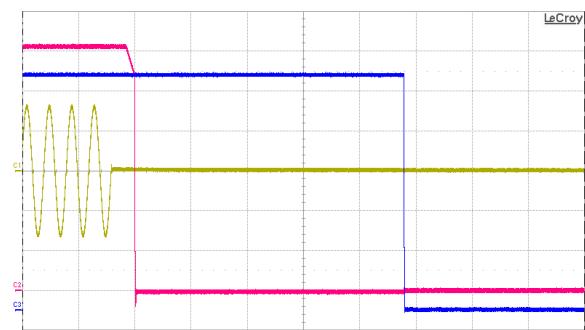


Figure 10. Turn-Off AC Line 230 VAC, full load (50 ms/div)
CH1: Vin (200V/div); CH2: V1 (2V/div); CH3: VSB (2V/div)

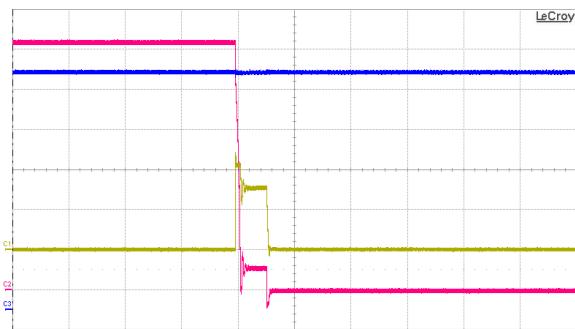


Figure 11. Short Circuit on V1 (20ms/div)
CH1: I1 (200 A/div); CH2: V1 (2V/div); CH3: VSB (2V/div)

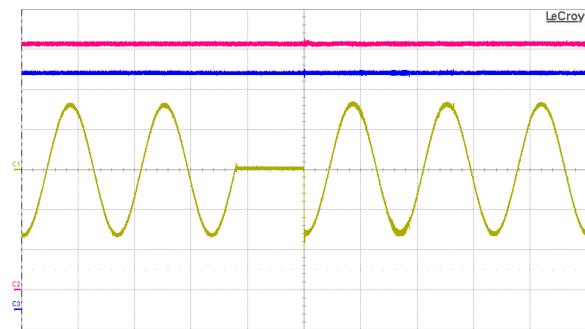


Figure 12. AC Drop Out 12ms, 80% full load (10ms/div)
CH1: Vin (200V/div); CH2: V1 (2V/div); CH3: VSB (2V/div)

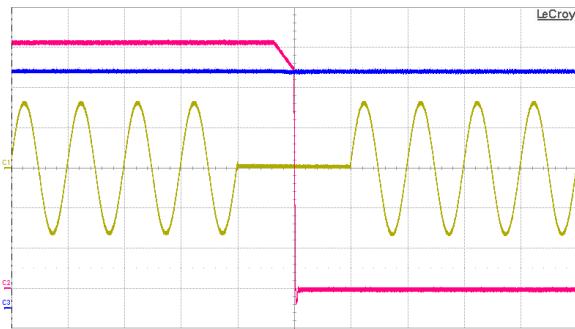


Figure 13. AC Drop Out 40 ms, full load (20 ms/div)
CH1: Vin (200 V/div); CH2: V1 (2 V/div); CH3: VSB (2 V/div)

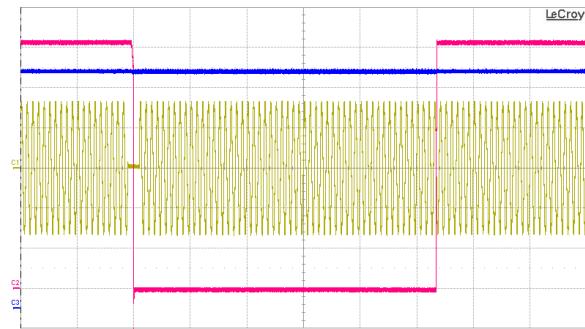


Figure 14. AC Drop Out 40 ms, full load (200 ms/div),
CH1: Vin (200 V/div); CH2: V1 (2 V/div); CH3: VSB (2 V/div)

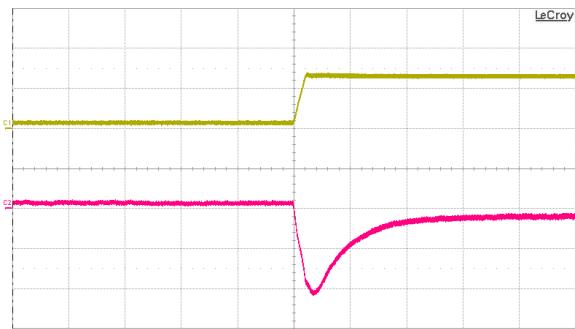


Figure 15. Load Transient V1, 12 to 134 A (500 μs/div)
CH1: I1 (100 A/div); CH2: V1 (200 mV/div)

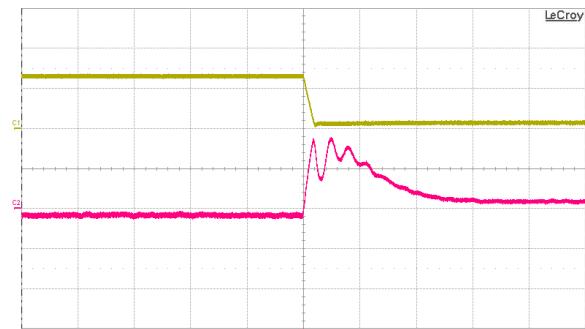


Figure 16. Load Transient V1, 134 to 12 A (500 μs/div)
CH1: I1 (100 A/div); CH2: V1 (200 mV/div)



Asia-Pacific

Europe, Middle East

North America

+86 755 298 85888

+353 61 49 8941

+1 866 513 2839

© 2023 Bel Power Solutions & Protection

BCD.20002_B

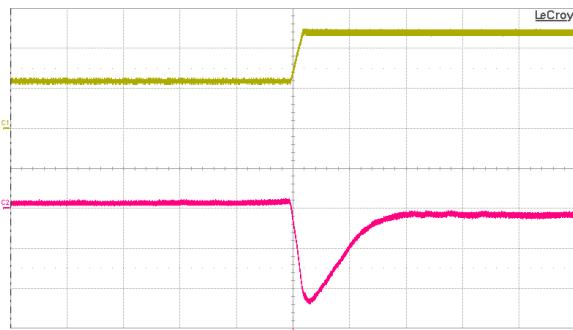


Figure 17. Load Transient V_1 , 122 to 244 A (500 μ s/div)
 CH1: I_1 (100 A/div); CH2: V_1 (200 mV/div)

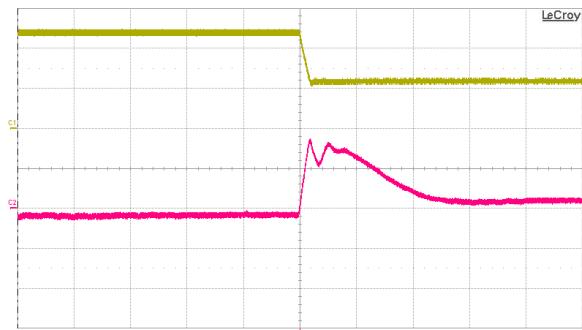


Figure 18. Load Transient V_1 , 244 to 122 A (500 μ s/div)
 CH1: I_1 (100 A/div); CH2: V_1 (200 mV/div)

6. PROTECTION

| PARAMETER | DESCRIPTION / CONDITION | MIN | NOM | MAX | UNIT | |
|--------------------------------|------------------------------------------------|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|------------|------------------------|------------|----|
| F | Input Fuses (L+N) | | 25 | | A | |
| $V_{1\text{ ov}}$ | OV Threshold V_1 | 13.6 | 14.2 | 14.8 | VDC | |
| $t_{\text{ov} V_1}$ | OV Latch Off Time V_1 | | 1 | | ms | |
| $V_{\text{SB ov}}$ | OV Threshold V_{SB} | 13.3 | 13.9 | 14.5 | VDC | |
| $t_{\text{ov} V_{\text{SB}}}$ | OV Latch Off Time V_{SB} | | 1 | | ms | |
| $I_{1\text{ lim}}$ | Current Limitation V_1 | $V_1 < 180 \text{ VAC}, T_a < 45^\circ\text{C}$ $V_1 < 180 \text{ VAC}, T_a = 60^\circ\text{C}$ ⁴⁾ $V_1 > 180 \text{ VAC}, T_a < 45^\circ\text{C}$ $V_1 > 180 \text{ VAC}, T_a = 60^\circ\text{C}$ ⁴⁾ | 264 215 | 272 223 | 280 231 | A |
| $t_{V_1\text{ lim}}$ | Current Limit Blanking Time | Time to latch off when in over current | 20 | 25 | 30 | ms |
| $I_{1\text{ ol lim}}$ | Current Limit During Short Time Overload V_1 | Maximum duration 20ms | 292 | 300 | 308 | A |
| $I_{1\text{ sc}}$ | Max Short Circuit Current V_1 | $V_1 < 3\text{V}$ | | 350 ⁵⁾ | A | |
| $t_{V_1\text{ sc off}}$ | Short Circuit Latch Off Time | Time to latch off when in short circuit | | 10 | | ms |
| $I_{\text{SB lim}}$ | Current Limitation V_{SB} | | 3.45 | 4.05 | A | |
| $t_{V_{\text{SB}}\text{ lim}}$ | Current Limit Blanking Time | Time to hit hiccup when in over current | | 1 | ms | |
| T_{SD} | Over Temperature on Critical Points | Inlet ambient temperature PFC heatsink temperature DC-DC primary heatsink temperature OR-ing Mosfet temperature | | 60 85 105 115 | °C | |

⁴⁾ See Figure 20 for linear derating $> 45^\circ\text{C}$

⁵⁾ Limit set doesn't include effects of main output capacitive discharge.

6.1 OVERVOLTAGE PROTECTION

The PSU provide a fixed threshold overvoltage (OV) protection implemented with a HW comparator. Once an OV condition has been triggered, the supply will shut down and latch the fault condition.

6.2 UNDERRVOLTAGE DETECTION

Both main and standby outputs are monitored. LED and PWOK_L pin signal if the output voltage exceeds $\pm 7\%$ of its nominal voltage.

Output undervoltage protection is provided on both outputs. When either V_1 or V_{SB} falls below 93% of its nominal voltage, the output is inhibited.



tech.support@psbel.com
belfuse.com/power-solutions

6.3 CURRENT LIMITATION

MAIN OUTPUT

Two different over current protection features are implemented on the main output.

A static over current protection will shut down the output, if the output current does exceed $I_{V1\ lim}$ for more than 20ms. If the output current is increased slowly this protection will shut down the supply.

The main output current limitation level $I_{V1\ lim}$ will decrease if the ambient (inlet) temperature increases beyond 45 °C (see Figure 20).

The 2nd protection is a substantially rectangular output characteristic controlled by a software feedback loop. This protects the power supply and system during the 20 ms blanking time of the static over current protection. If the output current is rising fast and reaches $I_{V1\ ol\ lim}$, the supply will immediately reduce its output voltage to prevent the output current from exceeding $I_{V1\ ol\ lim}$. When the output current is reduced below $I_{V1\ ol\ lim}$, the output voltage will return to its nominal value.

When the main output over current, the V_1 will shut down for 10sec and restart automatically. The supply will auto-restart from a fault up to 5 times, after that it will latch off. The latch and restart counter can be cleared by recycling the input voltage or the PSON_L input. A failure on the Main output will shut down only the Main output, while Standby continues to operate.

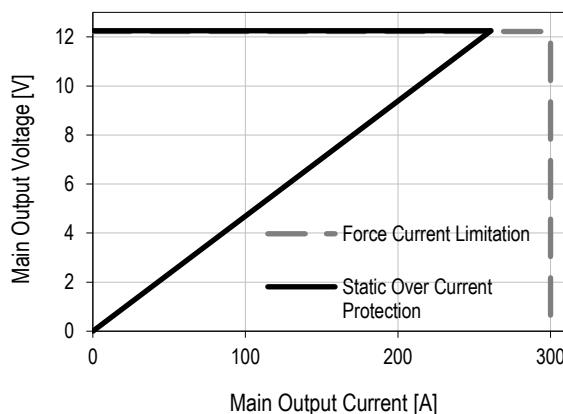


Figure 19. Current Limitation on V_1 ($V_1 = 230VAC$)

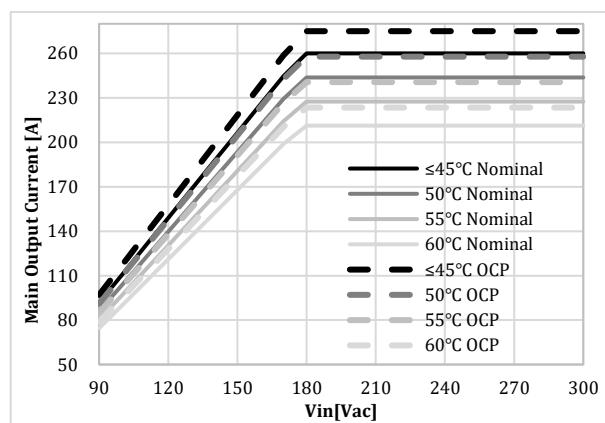


Figure 20. Derating on V_1 vs T_a & V_{in}

| Vin(Vac) | ≤45C | ≤45C | ≤50C | ≤50C | ≤55C | ≤55C | ≤60C | ≤60C |
|----------|--------------|--------------|-------------|--------------|-------------|-------------|-------------|-------------|
| | Iout_Nom (A) | Iout_OC P(A) | Iout_Nom(A) | Iout_OC P(A) | Iout_Nom(A) | Iout_OCP(A) | Iout_Nom(A) | Iout_OCP(A) |
| 90 | 92 | 97 | 86 | 91 | 80 | 85 | 75 | 79 |
| 100 | 111 | 117 | 104 | 110 | 97 | 103 | 90 | 95 |
| 110 | 130 | 137 | 122 | 129 | 114 | 120 | 106 | 112 |
| 120 | 149 | 158 | 140 | 148 | 130 | 138 | 121 | 128 |
| 130 | 168 | 178 | 158 | 167 | 147 | 156 | 137 | 145 |
| 140 | 187 | 198 | 176 | 186 | 164 | 173 | 152 | 161 |
| 150 | 206 | 218 | 194 | 205 | 181 | 191 | 168 | 177 |
| 160 | 226 | 239 | 211 | 224 | 197 | 209 | 183 | 194 |
| 170 | 245 | 259 | 229 | 243 | 214 | 226 | 199 | 210 |
| 180 | 260 | 275 | 244 | 258 | 228 | 241 | 211 | 223 |
| 190 | 260 | 275 | 244 | 258 | 228 | 241 | 211 | 223 |
| 200 | 260 | 275 | 244 | 258 | 228 | 241 | 211 | 223 |
| 210 | 260 | 275 | 244 | 258 | 228 | 241 | 211 | 223 |
| 220 | 260 | 275 | 244 | 258 | 228 | 241 | 211 | 223 |
| 230 | 260 | 275 | 244 | 258 | 228 | 241 | 211 | 223 |
| 240 | 260 | 275 | 244 | 258 | 228 | 241 | 211 | 223 |
| 250-300 | 260 | 275 | 244 | 258 | 228 | 241 | 211 | 223 |

Main Output Nominal Output Current $I_{1\ nom}$ & Current Limitation $I_{V1\ lim}$ vs Inlet Temperature (degC) & Vin(Vac)



| | | |
|-------------------|---------------------|-----------------|
| Asia-Pacific | Europe, Middle East | North America |
| +86 755 298 85888 | +353 61 49 8941 | +1 866 513 2839 |

STANDBY OUTPUT

On the standby output a hiccup type over current protection is implemented. This protection will shut down the standby output immediately when standby current reaches or exceeds $I_{SB\ lim}$. After an off-time of 1s the output automatically tries to restart. If the overload condition is removed the output voltage will reach again its nominal value. At continuous overload condition the output will repeatedly trying to restart with 1s intervals. A failure on the Standby output will shut down both Main and Standby outputs.

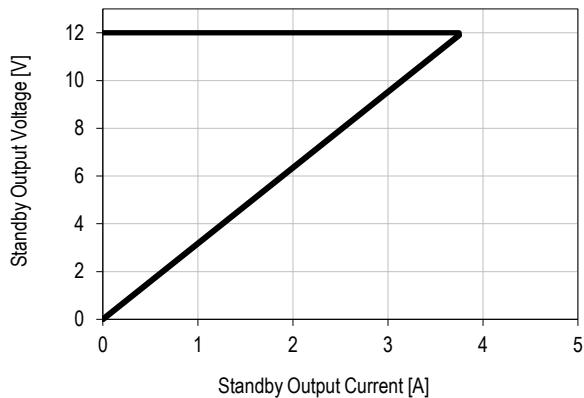


Figure 21. Current Limitation on V_{SB}

7. MONITORING

| PARAMETER | DESCRIPTION / CONDITION | MIN | NOM | MAX | UNIT |
|---------------|-------------------------|-------------------------------------------------------|------------|------------|-----------------------|
| V_{mon} | Input RMS Voltage | $V_{min} \leq V_i \leq V_{max}$ | -2.5 | +2.5 | % |
| I_{mon} | Input RMS Current | $I > 6 \text{ A}_{rms}$ $I \leq 6 \text{ A}_{rms}$ | -5 -0.3 | +5 +0.3 | % A_{rms} |
| P_{mon} | True Input Power | $P_i > 700 \text{ W}$ $P_i \leq 700 \text{ W}$ | -5 -35 | +5 +35 | % W |
| $V_{1\ mon}$ | V_1 Voltage | | -2 | +2 | % |
| $I_{1\ mon}$ | V_1 Current | $I_1 > 30 \text{ A}$ $I_1 \leq 30 \text{ A}$ | -2 -1 | +2 +1 | % A |
| $P_{o\ nom}$ | Total Output Power | $P_o > 200 \text{ W}$ $P_o \leq 200 \text{ W}$ | -5 -10 | +5 +10 | % W |
| $V_{SB\ mon}$ | Standby Voltage | | -2 | +2 | % |
| $I_{SB\ mon}$ | Standby Current | $I_{SB} \leq I_{SB\ nom}$ | -0.2 | +0.2 | A |



tech.support@psbel.com
belfuse.com/power-solutions

8. SIGNALING AND CONTROL

8.1 ELECTRICAL CHARACTERISTICS

| PARAMETER | DESCRIPTION | MIN | NOM | MAX | UNIT |
|--------------------------------------|---------------------------------------------------------------------------------------|-------------------|------|-----|------------|
| <i>PSKILL / PSON_L inputs</i> | | | | | |
| V_{IL} | Input low level voltage | -0.2 | 0.5 | 0.5 | V |
| V_{IH} | Input high level voltage | 2.0 | 3.6 | 3.6 | V |
| $I_{L,H}$ | Maximum input sink or source current | 0 | 1 | 1 | mA |
| $R_{puPSKILL}$ | Internal pull up resistor on PSKILL | | 10 | | k Ω |
| R_{puPSON_L} | Internal pull up resistor on PSON_L | | 10 | | k Ω |
| <i>PWOK_L output</i> | | | | | |
| V_{OL} | Output low level voltage | $I_{sink} < 4$ mA | -0.2 | 0.4 | V |
| V_{puPWOK_L} | External pull up voltage | | 12 | 12 | V |
| R_{puPWOK_L} | Recommended external pull up resistor on PWOK_L at $V_{puPWOK_L} = 3.3$ V | | 10 | | k Ω |
| <i>Low level output</i> | All outputs are turned on and within regulation | | | | |
| <i>High level output</i> | In standby mode or V_1/V_{SS} have triggered a fault condition | | | | |
| <i>INOK_L output</i> | | | | | |
| V_{OL} | Output low level voltage | $I_{sink} < 4$ mA | -0.2 | 0.4 | V |
| V_{puINOK_L} | External pull up voltage | | 12 | 12 | V |
| R_{puINOK_L} | Recommended external pull up resistor on INOK_L at $V_{puINOK_L} = 3.3$ V | | 10 | | k Ω |
| <i>Low level output</i> | Input voltage is within range for PSU to operate | | | | |
| <i>High level output</i> | Input voltage is not within range for PSU to operate | | | | |
| <i>SMB_ALERT_L output</i> | | | | | |
| V_{OL} | Output low level voltage | $I_{sink} < 4$ mA | -0.2 | 0.4 | V |
| $V_{puSMB_ALERT_L}$ | External pull up voltage | | 12 | 12 | V |
| $R_{puSMB_ALERT_L}$ | Recommended external pull up resistor on SMB_ALERT_L at $V_{puSMB_ALERT_L} = 3.3$ V | | 10 | | k Ω |
| <i>Low level output</i> | PSU in warning or failure condition | | | | |
| <i>High level output</i> | PSU is ok | | | | |

8.2 INTERFACING WITH SIGNALS

A 15V zener diode is added on all signal pins versus signal ground SGND to protect internal circuits from negative and high positive voltage. Signal pins of several supplies running in parallel can be interconnected directly. A supply having no input power will not affect the signals of the paralleled supplies.

ISHARE pins must be interconnected without any additional components. This in-/output also has a 15 V zener diode as a protection device and is disconnected from internal circuits when the power supply is switched off.



Asia-Pacific Europe, Middle East North America

+86 755 298 85888 +353 61 49 8941 +1 866 513 2839

© 2023 Bel Power Solutions & Protection

BCD.20002_B

8.3 FRONT LEDs

The front-end has 2 front LEDs showing the status of the supply. LED number one is green and indicates AC power is on or off, while LED number two is bi-colored: green and yellow and indicates DC power presence or fault situations. For the position of the LEDs see *Table 1* lists the different LED status.

| OPERATING CONDITION | LED SIGNALING |
|-----------------------------------------------------|-----------------------------|
| AC LED | |
| AC Line Within Range | Solid Green |
| AC Line UV Condition | |
| DC LED⁶⁾ | |
| Normal Operation | Solid Green |
| PSON_L High | Blinking Yellow (1:1) |
| V_1 or V_{SB} Out Of Regulation | |
| Over Temperature Shutdown | |
| Output Over Voltage Shutdown (V_1 or V_{SB}) | Solid Yellow |
| Output Under Voltage Shutdown (V_1 or V_{SB}) | |
| Output Over Current Shutdown (V_1 or V_{SB}) | |
| Over Temperature Warning | Blinking Yellow/Green (2:1) |
| Minor Fan Regulation Error (>5%, <15%) | Blinking Yellow/Green (1:1) |

⁶⁾ The order of the criteria in the table corresponds to the testing precedence in the controller.

Table 1. LED Status

8.4 PRESENT_L

The PRESENT_L is normally a trailing pin within the connector and will contact only once all other connector contacts are closed. This active-low pin is used to indicate to a power distribution unit controller that a supply is plugged in. The maximum sink current on PRESENT_L pin should not exceed 10 mA.

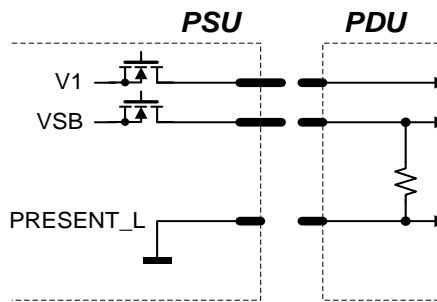


Figure 22. PRESENT_L Signal Pin

8.5 PSKILL INPUT

The PSKILL input is an active-high and normally a trailing pin in the connector and is used to disconnect the main output as soon as the power supply is being plugged out. This pin should be connected to SGND in the power distribution unit. The standby output will remain on regardless of the PSKILL input state.



tech.support@psbel.com
belfuse.com/power-solutions

8.6 AC TURN-ON / DROP-OUTS / INOK_L

The power supply will automatically turn-on when connected to the AC line under the condition that the PSON_L signal is pulled low and the AC line is within range. The INOK_L is an open collector output that requires an external pull-up to a maximum of 12V indicating whether the input is within the range the power supply can use and turn on. The INOK_L signal is active-low. The timing diagram is shown in *Figure 23* and referenced in *Table 2*.

| OPERATING CONDITION | | MIN | MAX | UNIT |
|---------------------|-------------------------------------------------|------|-----|------|
| $t_{AC\ VSB}$ | AC Line to 90% V_{SB} | 3 | sec | |
| $t_{AC\ V1}$ | AC Line to 90% V_1 | 3 | sec | |
| $t_{INOK_L\ on1}$ | INOK_L signal on delay (start-up) | 1800 | ms | |
| $t_{INOK_L\ on2}$ | INOK_L signal on delay (dips) | 0 | 100 | ms |
| $t_{V1\ holdup}$ | Effective V_1 holdup time | 12 | 300 | ms |
| $t_{VSB\ holdup}$ | Effective V_{SB} holdup time | 40 | 300 | ms |
| $t_{INOK_L\ V1}$ | INOK_L to V_1 holdup | 7 | ms | |
| $t_{INOK_L\ VSB}$ | INOK_L to V_{SB} holdup | 27 | ms | |
| $t_{V1\ off}$ | Minimum V_1 off time | 1000 | ms | |
| $t_{VSB\ off}$ | Minimum V_{SB} off time | 1000 | ms | |
| $t_{V1\ dropout}$ | Minimum V_1 dropout time (0.8* $I_{1\ nom}$) | 12 | ms | |
| $t_{VSB\ dropout}$ | Minimum V_{SB} dropout time | 40 | ms | |

Table 2. AC Turn-on / Dip Timing

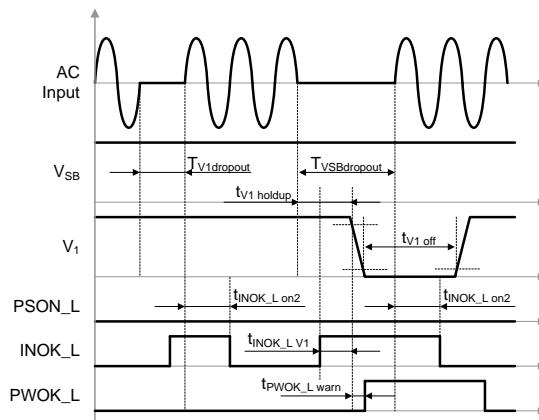


Figure 24. AC Short Dips

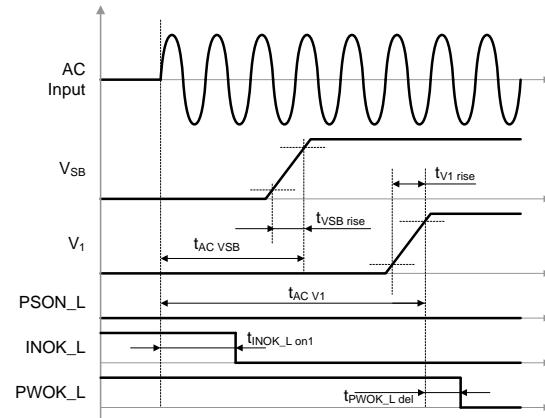


Figure 23. AC Turn-On Timing

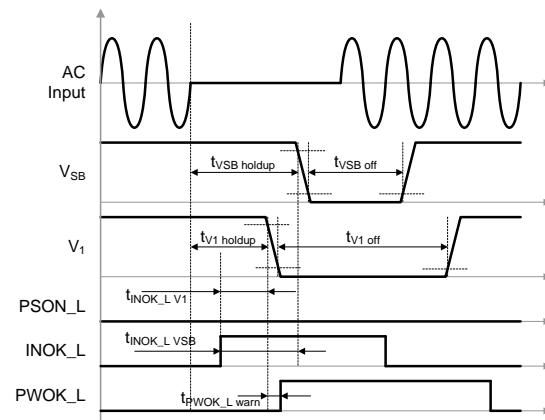


Figure 25. AC Long Dips

8.7 PSON_L INPUT

The PSON_L is an internally pulled-up (3.3V) input signal to enable / disable the main output V_1 of the front-end. This active-low pin is also used to clear any latched fault condition. The timing diagram is given in *Figure 26* and the parameters in *Table 3*.

| OPERATING CONDITION | | MIN | MAX | UNIT |
|----------------------|-----------------------------|-----|-----|------|
| $t_{PSON_L\ V1on}$ | PSON_L to V_1 Delay (on) | 150 | 250 | ms |
| $t_{PSON_L\ V1off}$ | PSON_L to V_1 Delay (off) | 0 | 100 | ms |

Table 3. PSON_L Timing



| Asia-Pacific | Europe, Middle East | North America |
|-------------------|---------------------|-----------------|
| +86 755 298 85888 | +353 61 49 8941 | +1 866 513 2839 |

© 2023 Bel Power Solutions & Protection

BCD.20002_B

8.8 PWOK_L SIGNAL

The PWOK_L is an open collector output that requires an external pull-up to a maximum of 12 V indicating whether both V_{SB} and V_1 outputs are within regulation. This pin is active-low. The timing diagram is shown in *Figure 26* and referenced in *Table 4*.

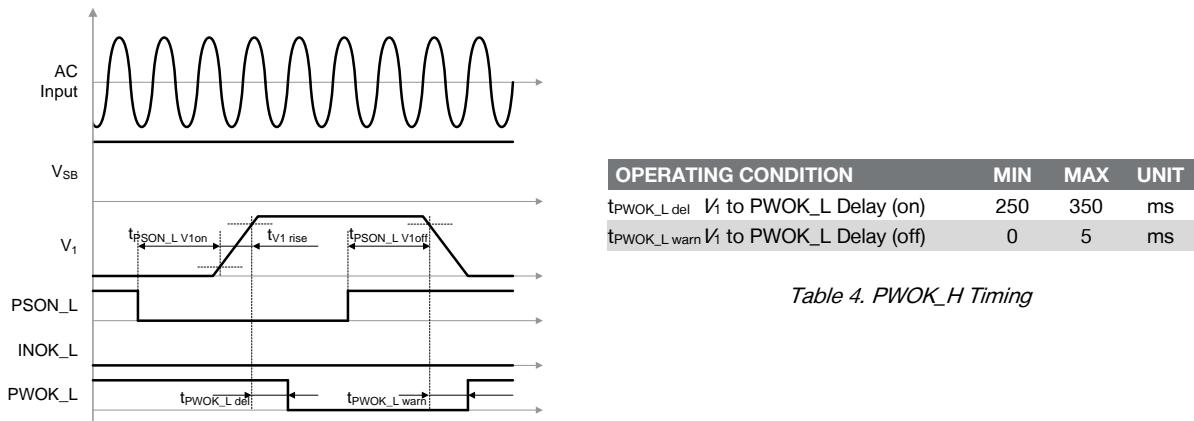


Figure 26. PSON_L Turn-on/off Timing

8.9 CURRENT SHARE

The PSU have an active current share scheme implemented for V_1 . All the ISHARE current share pins need to be interconnected in order to activate the sharing function. If a supply has an internal fault or is not turned on, it will disconnect its ISHARE pin from the share bus. This will prevent dragging the output down (or up) in such cases.

The current share function uses an analog bus. The controller implements a Master/Slave current share function. The power supply providing the largest current among the group is automatically the Master. The other supplies will operate as Slaves and increase their output current to a value close to the Master by slightly increasing their output voltage. The voltage increase is limited to +250 mV.

The standby output uses a passive current share method (droop output voltage characteristic).

| No of paralleled PSUs | Maximum available power on main 12V without redundancy | Maximum available power on main 12V with n+1 redundancy | Maximum available power on standby output |
|-----------------------|--------------------------------------------------------|---------------------------------------------------------|-------------------------------------------|
| 1 | 3,200 W | - | 36 W |
| 2 | 6,240 W | 3,200 W | 36 W |
| 3 | 9,280 W | 6,240 W | 36 W |
| 4 | 12,320 W | 9,280 W | 36 W |
| 5 | 15,360 W | 12,320 W | 36 W |
| 6 | 18,400 W | 15,360 W | 36 W |

Table 5. Power Available When PSU in Redundant Operation

8.10 SENSE INPUTS

Main output has sense lines implemented to compensate for voltage drop on load wires. The maximum allowed voltage drop is 200 mV on the positive rail and 100 mV on the PGND rail.

With open sense inputs the main output voltage will rise by 250 mV. Therefore, if not used, these inputs should be connected to the power output and PGND close to the power supply connector. The sense inputs are protected against short circuit. In this case the power supply will shut down.



tech.support@psbel.com
belfuse.com/power-solutions

8.11 I²C / POWER MANAGEMENT BUS COMMUNICATION

The interface driver in the power supply is referenced to the SGND. The power supply is a communication slave device only; it never initiates messages on the I²Cbuses by itself. The communication bus voltage and timing is defined in *Table 6* and further characterized through:

- There are 10kΩ internal pull-up resistors
- The SDA/SCL IOs must be pull-up externally to 3.3 ± 0.3 V
- Pull-up resistor should be 2 – 5 kΩ to ensure SMBUS compliant signal rise times
- I²C clock speed up to 100 kbps
- Clock stretching limited to 1 ms
- SCL low time-out of >25 ms with recovery within 10 ms
- Recognizes any time Start/Stop bus conditions

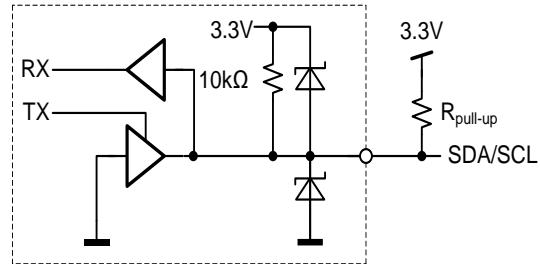


Figure 27. Physical Layer of Communication Interface

The SMB_ALERT_L signal indicates that the power supply is experiencing a problem that the system agent should investigate. This is a logical OR of the Shutdown and Warning events.

Communication to the DSP or the EEPROM will be possible as long as the input AC (DC) voltage is provided. If no AC (DC) is present, communication to the unit is possible as long as it is connected to a live V_{SB} output (provided e.g. by the redundant unit). If only V_I is provided, communication is not possible.

| PARAMETER | DESCRIPTION | CONDITION | MIN | MAX | UNIT |
|------------------|----------------------------------------------------|-------------------------------------------|---------------|---------------------------|------|
| V_L | Input low voltage | | -0.2 | 0.4 | V |
| V_H | Input high voltage | | 2.1 | 3.6 | V |
| V_{hys} | Input hysteresis | | 0.15 | | V |
| V_{oL} | Output low voltage | 4 mA sink current | 0 | 0.4 | V |
| t_r | Rise time for SDA and SCL | | $20+0.1C_b^1$ | 300 | ns |
| t_{of} | Output fall time $V_{iHmin} \rightarrow V_{iLmax}$ | $10 \text{ pF} < C_b^1 < 400 \text{ pF}$ | $20+0.1C_b^1$ | 250 | ns |
| I | Input current SCL/SDA | $0.1 \text{ VDD} < V_i < 0.9 \text{ VDD}$ | -10 | 10 | µA |
| C_i | Capacitance for each SCL/SDA | | | 47 | pF |
| f_{SCL} | SCL clock frequency | | 0 | 100 | kHz |
| R_{pu} | External pull-up resistor | $f_{SCL} \leq 100 \text{ kHz}$ | | $1000 \text{ ns} / C_b^7$ | Ω |
| t_{HDDST} | Hold time (repeated) START | $f_{SCL} \leq 100 \text{ kHz}$ | 4.0 | | µs |
| t_{LOW} | Low period of the SCL clock | $f_{SCL} \leq 100 \text{ kHz}$ | 4.7 | | µs |
| t_{HIGH} | High period of the SCL clock | $f_{SCL} \leq 100 \text{ kHz}$ | 4.0 | | µs |
| t_{SUSTA} | Setup time for a repeated START | $f_{SCL} \leq 100 \text{ kHz}$ | 4.7 | | µs |
| t_{HDDAT} | Data hold time | $f_{SCL} \leq 100 \text{ kHz}$ | 0 | 3.45 | µs |
| t_{SUDAT} | Data setup time | $f_{SCL} \leq 100 \text{ kHz}$ | 250 | | ns |
| t_{SUSTO} | Setup time for STOP condition | $f_{SCL} \leq 100 \text{ kHz}$ | 4.0 | | µs |
| t_{BUF} | Bus free time between STOP and START | $f_{SCL} \leq 100 \text{ kHz}$ | 5 | | ms |
| EEPROM_WP | | | | | |
| V_L | Input low voltage | | -0.2 | 0.4 | V |
| V_H | Input high voltage | | 2.1 | 3.6 | V |
| I | Input sink or source current | | -1 | 1 | mA |
| R_{pu} | Internal pull-up resistor to 3.3V | | | 10k | Ω |

⁷⁾ $C_b =$ Capacitance of bus line in pF, typically in the range of 10...400 pF

Table 6. I²C / SMBus Specification



| Asia-Pacific | Europe, Middle East | North America |
|-------------------|---------------------|-----------------|
| +86 755 298 85888 | +353 61 49 8941 | +1 866 513 2839 |

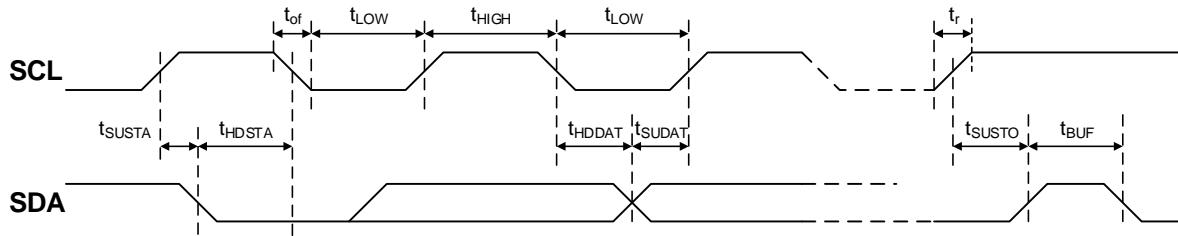



Figure 28. PC / SMBus Timing

8.12 ADDRESS SELECTION

The supply supports Power Management Bus communication protocol, address for Power Management Bus communication is at fixed to 0x20. The EEPROM is at fixed address = 0xA0.

8.13 CONTROLLER AND EEPROM ACCESS

The controller and the EEPROM in the power supply share the same I²C bus physical layer (see *Figure 29*). In order to write to the EEPROM, the write protection needs to be disabled by setting EEPROM_WP input correctly. If EEPROM_WP is High, write is not allowed to the EEPROM and if Low, write is allowed. The EEPROM provides 2K bits of user memory. None of the bytes are used for the operation of the power supply.

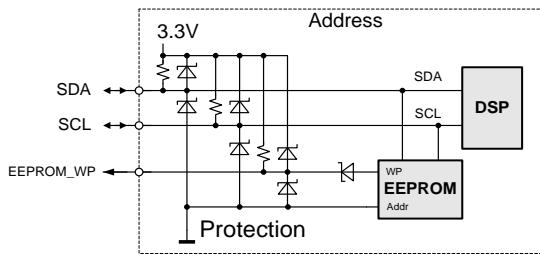Figure 29. I²C Bus to DSP and EEPROM

8.14 EEPROM PROTOCOL

The EEPROM follows the industry communication protocols used for this type of device. Even though page write / read commands are defined, it is recommended to use the single byte write / read commands.


WRITE

The write command follows the SMBus 1.1 Write Byte protocol. After the device address with the write bit cleared a first byte with the data address to write to is sent followed by the data byte and the STOP condition. A new START condition on the bus should only occur after 5ms of the last STOP condition to allow the EEPROM to write the data into its memory.



READ

The read command follows the SMBus 1.1 Read Byte protocol. After the device address with the write bit cleared the data address byte is sent followed by a repeated start, the device address and the read bit set. The EEPROM will respond with the data byte at the specified location.



tech.support@psbel.com
belfuse.com/power-solutions

8.15 POWER MANAGEMENT BUS PROTOCOL


The Power Management Bus is an open standard protocol that defines means of communicating with power conversion and other devices. For more information, please see the System Management Interface Forum web site at: www.powerSIG.org. Power Management Bus command codes are not register addresses. They describe a specific command to be executed.

TET3200-12-069RA supply supports the following basic command structures:


- Clock stretching limited to 1 ms
- SCL low time-out of >25 ms with recovery within 10 ms
- Recognized any time Start/Stop bus conditions

WRITE

The write protocol is the SMBus 1.1 Write Byte/Word protocol. Note that the write protocol may end after the command byte or after the first data byte (Byte command) or then after sending 2 data bytes (Word command).

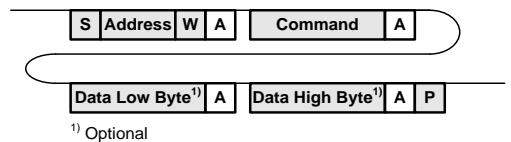


In addition, Block write commands are supported with a total maximum length of 255 bytes. See TET3200-12-069RA Programming Manual for further information.




READ

The read protocol is the SMBus 1.1 Read Byte/Word protocol. Note that the read protocol may request a single byte or word.

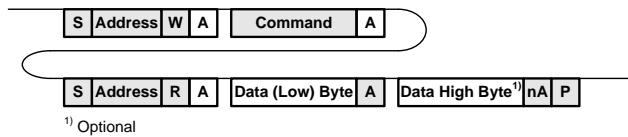

In addition, Block read commands are supported with a total maximum length of 255 bytes. See TET3200-12-069RA Power Management Bus Communication Manual URP.00560 for further information.



| Asia-Pacific | Europe, Middle East | North America |
|-------------------|---------------------|-----------------|
| +86 755 298 85888 | +353 61 49 8941 | +1 866 513 2839 |

© 2023 Bel Power Solutions & Protection

8.16 GRAPHICAL USER INTERFACE

Bel Power Solutions provides I²C Utility™ a Windows® XP/Vista/Win7 compatible graphical user interface allowing the programming and monitoring of the TET3200-12-069RA Front-End. The utility can be downloaded on befuse.com/power-solutions and supports both the PSMI and Power Management Bus protocols.

The GUI allows automatic discovery of the units connected to the communication bus and will show them in the navigation tree. In the monitoring dialog, the power supply can be controlled and monitored.

If the GUI is used in conjunction with the TET3200-12-069RA Evaluation Kit it is also possible to control the PSON_L pin(s) of the power supply.

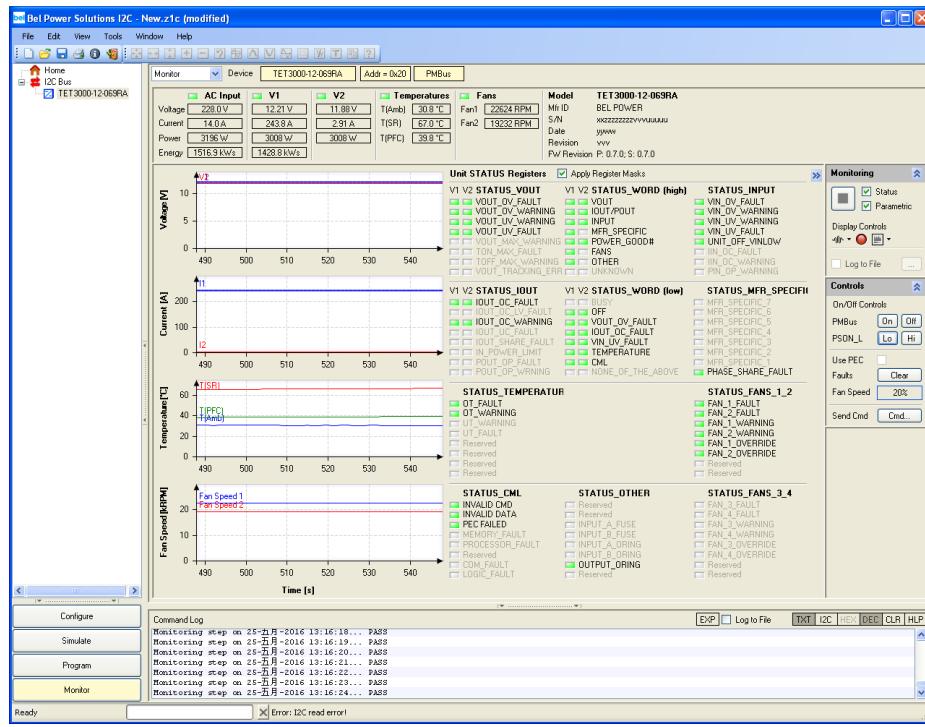


Figure 30. Monitoring dialog of the I²C Utility

9. TEMPERATURE AND FAN CONTROL

To achieve best cooling results sufficient airflow through the supply must be ensured. Do not block or obstruct the airflow at the rear of the supply by placing large objects directly at the output connector. The air enters through the front of the supply and leaves at the rear. The PSU has been designed for horizontal operation.

The fan inside of the supply is controlled by a microprocessor. The rpm of the fan is adjusted to ensure optimal supply cooling and is a function of output power and the inlet temperature.




Figure 31. Airflow Direction of TET3200-12-069RA



tech.support@psbel.com
befuse.com/power-solutions

| Vin(Vac) | ≤45C | ≤50C | ≤55C | ≤60C |
|----------|-------------|-------------|-------------|-------------|
| | Pout_Nom(W) | Pout_Nom(W) | Pout_Nom(W) | Pout_Nom(W) |
| 90 | 1130 | 1060 | 990 | 920 |
| 100 | 1360 | 1280 | 1190 | 1110 |
| 110 | 1600 | 1500 | 1400 | 1300 |
| 120 | 1830 | 1720 | 1600 | 1490 |
| 130 | 2070 | 1940 | 1810 | 1680 |
| 140 | 2300 | 2160 | 2020 | 1870 |
| 150 | 2540 | 2380 | 2220 | 2060 |
| 160 | 2770 | 2600 | 2430 | 2250 |
| 170 | 3010 | 2820 | 2630 | 2450 |
| 180 | 3200 | 3000 | 2800 | 2600 |
| 190 | 3200 | 3000 | 2800 | 2600 |
| 200 | 3200 | 3000 | 2800 | 2600 |
| 210 | 3200 | 3000 | 2800 | 2600 |
| 220 | 3200 | 3000 | 2800 | 2600 |
| 230 | 3200 | 3000 | 2800 | 2600 |
| 240 | 3200 | 3000 | 2800 | 2600 |
| 250-300 | 3200 | 3000 | 2800 | 2600 |

Table 7. Main Output Nominal Output Power P1 nomill vs Inlet Temperature (degC) & Vin(Vac)

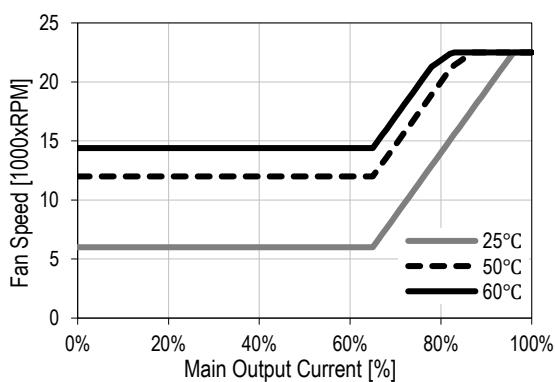


Figure 32. Fan Speed vs. Main Output Load

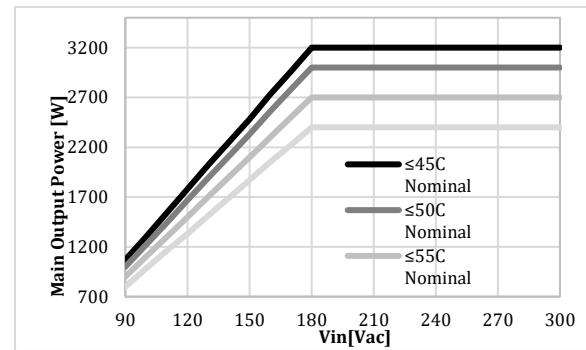


Figure 33. Thermal Derating

10. ELECTROMAGNETIC COMPATIBILITY

10.1 IMMUNITY

| PARAMETER | DESCRIPTION / CONDITION | CRITERION |
|---------------------------------|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-------------------------|
| ESD Contact Discharge | IEC / EN 61000-4-2, ±8 kV, 25+25 discharges per test point (metallic case, LEDs, connector body) | A |
| ESD Air Discharge | IEC / EN 61000-4-2, ±15 kV, 25+25 discharges per test point (non-metallic user accessible surfaces) | A |
| Radiated Electromagnetics Filed | IEC / EN 61000-4-3, 10 V/m, 1 kHz/80% Amplitude Modulation, 1 μs Pulse Modulation, 10 kHz...2 GHz | A |
| Burst | AC port ±2 kV, 1 minute DC port ±1 kV, 1 minute | A |
| Surge | Line to earth: level 3, ±2 kV Line to line: level 2, ±1 kV | A |
| RF Conducted Immunity | IEC/EN 61000-4-6, Level 3, 10 Vrms, CW, 0.1 ... 80 MHz | A |
| Voltage Dips and Interruptions | IEC/EN 61000-4-11 1) Vi 230Volts, 80% Load, Dip 100%, Duration 12ms 2) Vi 230Volts, 100% Load, Dip 100%, Duration < 50 ms 3) Vi 230Volts, 100% Load, Dip 100%, Duration > 50 ms | A V1: B; VSB: A B |



10.2 EMISSION

| PARAMETER | DESCRIPTION / CONDITION | CRITERION |
|--------------------|--------------------------------------------------------------------------------|-----------|
| Conducted Emission | EN55022 / CISPR 22: 0.15 ... 30 MHz, QP and AVG | Class A |
| Radiated Emission | EN55022 / CISPR 22: 30 MHz ... 1 GHz, QP | Class A |
| Harmonic Emissions | IEC61000-3-2, Vin = 230 VAC, 50 Hz, 100% Load | Class A |
| AC Flicker | IEC / EN 61000-3-3, d _{max} < 3.3% | Pass |
| Acoustical Noise | Sound power statistical declaration (ISO 9296, ISO 7779, IS9295) @ 50% load | 60 dBA |

11. SAFETY / APPROVALS

Maximum electric strength testing is performed in the factory according to IEC/EN 62368-1 & UL/CSA 62368-1. Input-to-output electric strength tests should not be repeated in the field. Bel Power Solutions will not honor any warranty claims resulting from electric strength field tests.

| PARAMETER | DESCRIPTION / CONDITION | MIN | NOM | MAX | UNIT |
|--------------------------|--------------------------------------------------------------------------|--------------------|-------------------|-----|-----------------------------------|
| Agency Approvals | UL 62368-1, CAN/CSA-C22.2 No. 62368-1 IEC 62368-1 EN 62368-1 | | | | Approved |
| Isolation Strength | Input (L/N) to case (PE) Input (L/N) to output Output to case (PE) | | | | Basic Reinforced Functional |
| Creepage / Clearance | Primary (L/N) to protective earth (PE) Primary to secondary | 3.8/2.3 7.6/4.6 | | | mm |
| Electrical Strength Test | Input to enclosure Input to output Output and Signals to case | | 2.5 5.0 0.1 | | kVDC |

12. ENVIRONMENTAL

| PARAMETER | DESCRIPTION / CONDITION | MIN | NOM | MAX | UNIT |
|------------|---------------------------------------------------------------------------------------------------------------------------------------------|-----|-----|------|---------------------|
| T_A | Ambient Temperature V_i min to V_i max, I_i nom, I_{SB} nom at 5000m V_i min to V_i max, I_i nom, I_{SB} nom at 2000m | 0 | | +40 | °C |
| T_{Aext} | Extended Temp. Range | +45 | | +60 | °C |
| T_S | Storage Temperature | -40 | | +70 | °C |
| | Altitude | | | 5000 | m |
| N_a | Audible Noise | | 53 | | dBA |
| | Cooling | | | 0.5 | in-H ₂ O |



tech.support@psbel.com
belfuse.com/power-solutions

13. MECHANICAL

| PARAMETER | DESCRIPTION / CONDITION | MIN | NOM | MAX | UNIT |
|-----------------|-------------------------|-----|------|-----|------|
| Dimensions | Width | | 69 | | mm |
| | Height | | 40.5 | | mm |
| | Depth | | 555 | | mm |
| <i>M</i> Weight | | | 2.4 | | kg |

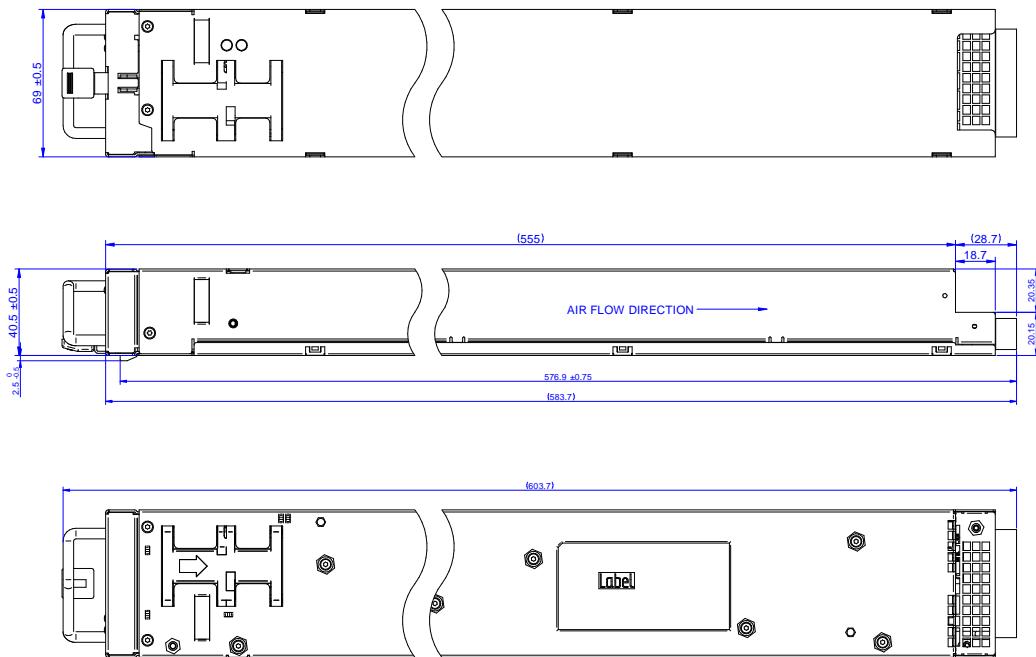


Figure 34. Bottom, top and side views

NOTE: A 3D step file of the power supply casing is available on request.

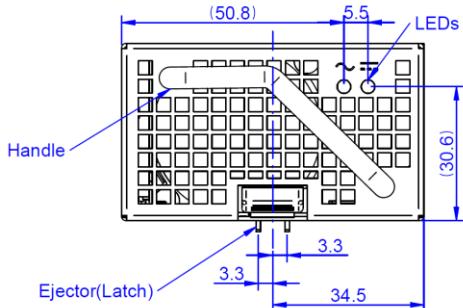


Figure 35. Front view

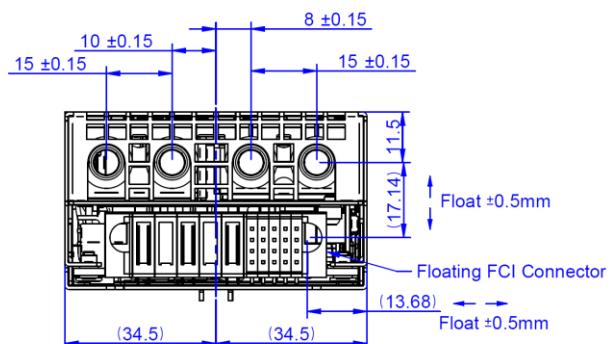


Figure 36. Rear view




| | | |
|-------------------|---------------------|-----------------|
| Asia-Pacific | Europe, Middle East | North America |
| +86 755 298 85888 | +353 61 49 8941 | +1 866 513 2839 |

© 2023 Bel Power Solutions & Protection

BCD.20002_B

14. CONNECTORS

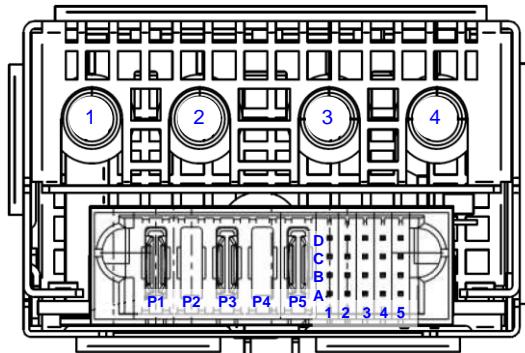

Unit: FCI Connectors P/N 51939-768LF or equivalent
 Counterpart: FCI Connectors P/N 51915-401LF
 Note: A1 and A2 are Trailing Pin (short pins)
 For Main Output Pins, see section 15

| PIN | NAME | DESCRIPTION |
|---------------------|-------------|-------------------------------------------------|
| Output Pins | | |
| 3,4 | V1 | +12 VDC main output |
| 1,2 | PGND | +12 VDC main output ground |
| Input Pins | | |
| P1 | LIVE | AC Live Pin |
| P2 | N.C. | No metal pin connection |
| P3 | NEUTRAL | AC Neutral Pin |
| P4 | N.C. | No metal pin connection |
| P5 | P.E. | Protective Earth Pin |
| Control Pins | | |
| A1 | PSKILL | Power supply kill (trailing pin): active-high |
| B1 | PWOK_L | Power OK signal output: active-low |
| C1 | INOK_L | Input OK signal: active-low |
| D1 | PSON_L | Power supply on input: active-low |
| A2 | PRESENT_L | Power supply present (trailing pin): active-low |
| B2 | SGND | Signal ground ^⑧ (return) |
| C2 | SGND | Signal ground ^⑧ (return) |
| D2 | SGND | Signal ground ^⑧ (return) |
| A3 | SCL | I ² C clock signal line |
| B3 | SDA | I ² C data signal line |
| C3 | SMB_ALERT_L | SMB Alert signal output: active-low |
| D3 | ISHARE | V ₁ Current share bus |
| A4 | EEPROM_WP | EEPROM write protect |
| B4 | RESERVED | Reserved |
| C4 | V1_SENSE_R | Main output negative sense |
| D4 | V1_SENSE | Main output positive sense |
| A5 | VSB | Standby positive output |
| B5 | VSB | Standby positive output |
| C5 | VSB_GND | Standby Ground ^⑧ |
| D5 | VSB_GND | Standby Ground ^⑧ |

^⑧ These pins should be connected to PGND on the system.

See section 8 for pull up resistor settings of signal pins


All signal pins are referred to SGND




tech.support@psbel.com
belfuse.com/power-solutions

15. SHELF LEVEL CONFIGURATION (Provisional)


The recommended pin configuration below is based on company's own Shelf design and provided here as reference. Customer pin lengths within the range indicated is acceptable.

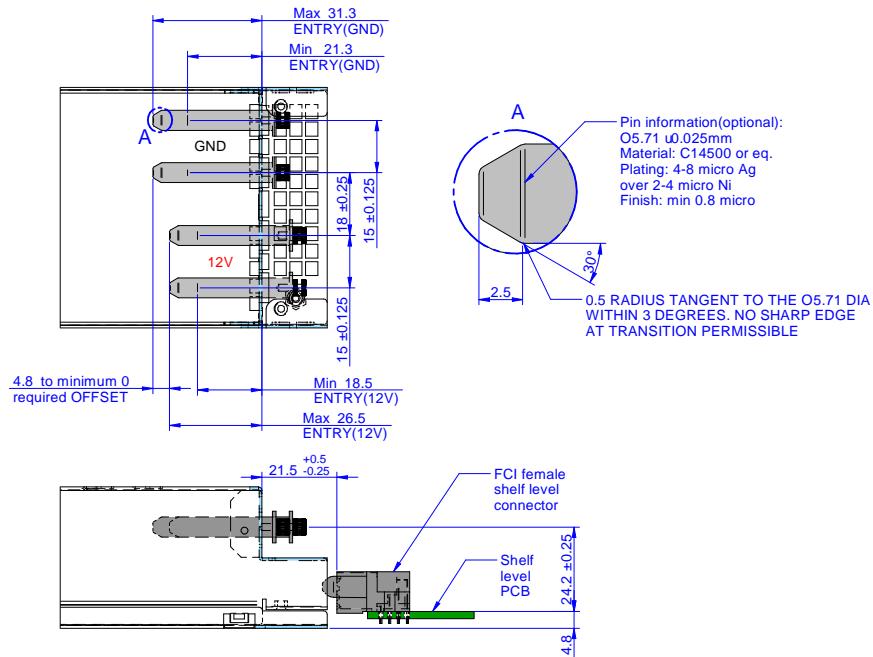

The recommended system bay configuration below is based on company's own Shelf design and provided here as a reference.

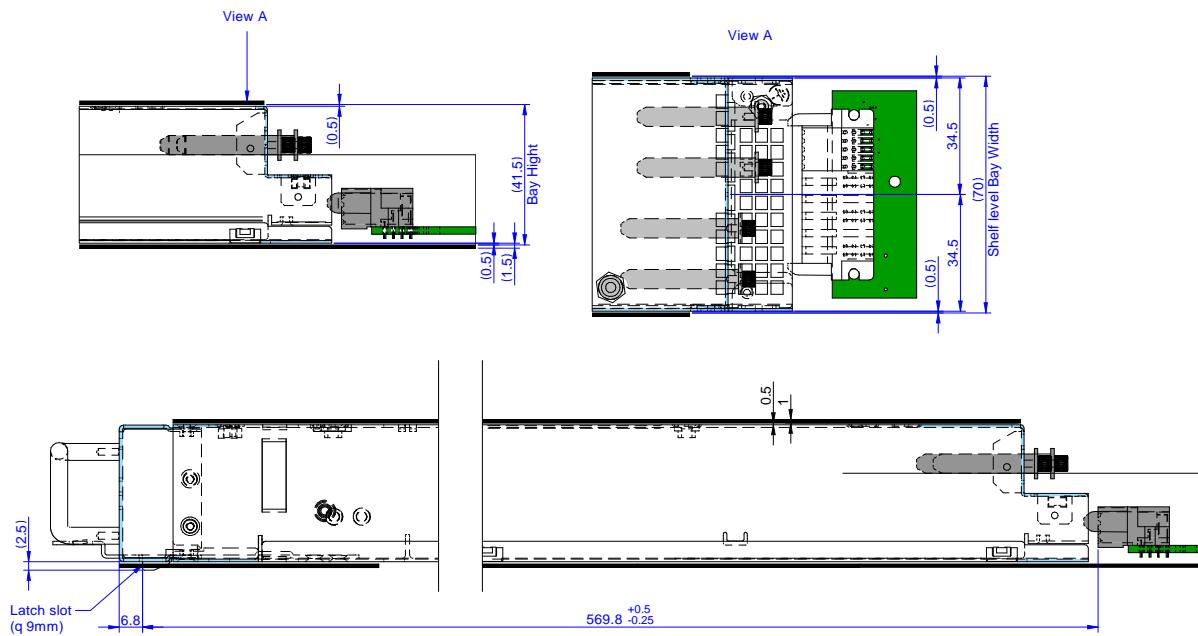

16. ACCESSORIES

| ITEM | DESCRIPTION | ORDERING PART NUMBER | SOURCE |
|-----------------------------------------------------------------------------------|----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-------------------------|--------------------------------------------------------------------------------|
|  | I²C Utility Windows XP/Vista/7 compatible GUI to program, control and monitor TET3200-12-069RA Front-Ends (and other I ² C units) | N/A | belfuse.com/lpower-solutions |
|  | Single Connector Board Connector board to operate TET3200-12-069RA unit. Includes an on-board USB to I ² C converter (use <i>I²C Utility</i> as desktop software). | YTM.G1S01.0 | belfuse.com/lpower-solutions |
|  | AC Can Filter Recommended AC can filter used on system side. | C20F.0011 20GENG3E-R | Schurter Inc. Delta Electronics |

17. REVISION HISTORY

| REVISION | DESCRIPTION OF CHANGES | DATE | ORIGINATOR |
|----------|-----------------------------------------------------------------------------------------------------------|------------|------------|
| A | Initial release | 2020-07-15 | Jun.li |
| B | Update the safety approve standard at section 11 Add "or equivalent" to output connector at section 14 | 2023-10-13 | Chad Cai |

For more information on these products consult: tech.support@psbel.com

NUCLEAR AND MEDICAL APPLICATIONS - Products are not designed or intended for use as critical components in life support systems, equipment used in hazardous environments, or nuclear control systems.

TECHNICAL REVISIONS - The appearance of products, including safety agency certifications pictured on labels, may change depending on the date manufactured. Specifications are subject to change without notice.



tech.support@psbel.com
belfuse.com/power-solutions