

**BeStar Technologies Inc.**

Address: 761 N. 17th Street Unit 4, St. Charles, IL 60174

Tel : 847-261-2850 E-mail : [sales@bestartech.com](mailto:sales@bestartech.com) Web : [www.bestartech.com](http://www.bestartech.com)

Document Number : 0411-14  
Revision : A3  
Total Pages : 6  
Prepare by : Loki, Lo  
Date : 12 October, 2018

**SENER** Brand Power Product[www.jlsener.com](http://www.jlsener.com)

Document Type : Specification  
Product Type : Lithium/Manganese Dioxide (LiMnO<sub>2</sub>) Coin Cell  
Ordering Code : SCR1220  
Cell Part Number : CR1220  
Cell UL Number : MH20926

A1 - New issue created by Leo, Sin on 4 Nov., 2004		
A2 - Updated format & layout by Holmes, Poon on 22 Nov., 2011		
A3 - Updated section 3 and 4 by Loki, Lo on 12 Oct., 2018		

This material is the property of BeStar Technologies Inc.  
Unauthorized copying or use of this material is prohibited.

1. Purpose and Scope

This document contains both general requirements, qualification requirements, and those specific electrical, mechanical requirements for this part.

2. Description

Ø12mm Lithium/Manganese Dioxide (LiMnO<sub>2</sub>) coin cell, RoHS compliant.

3. Application

Computers and Peripherals, Portable Equipment, etc.

4. Component Requirement

4.1. General Requirement

- 4.1.1. Operating Temperature Range : -20°C to +70°C
- 4.1.2. Storage Temperature Range : 0°C to +30°C
- 4.1.3. Storage Humidity : 40 ~ 75%
- 4.1.4. Weight : Approx. 0.8g
- 4.1.5. Materials of Positive Terminal : SUS stainless
- 4.1.6. Materials of Negative Terminal : SUS stainless

4.2. Electrical Requirement

- 4.2.1. Nominal Voltage : 3V
- 4.2.2. Nominal Capacity : 38mAh  
(under Load 62kΩ Load and 2.0V End-voltage)
- 4.2.3. Load Resistance : 62KΩ
- 4.2.4. Standard Discharge Current : 0.1mA

4.3. Standard Characteristics

4.3.1. Discharge Characteristics

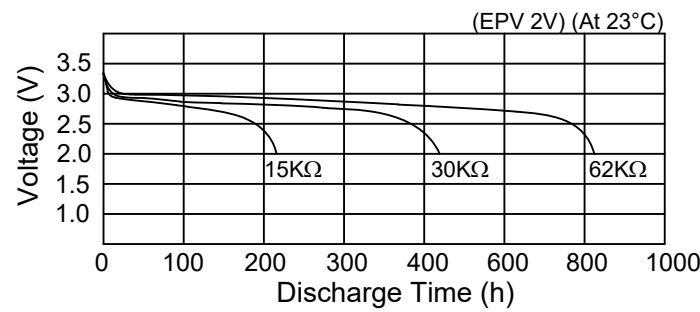


Figure 1. Discharge Characteristics

4.3.2. Load-Operating voltage

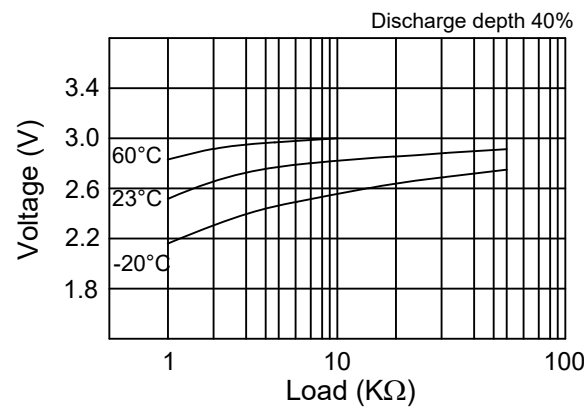


Figure 2. Load-Operating voltage

4.3.3. Pulse Discharge Characteristics

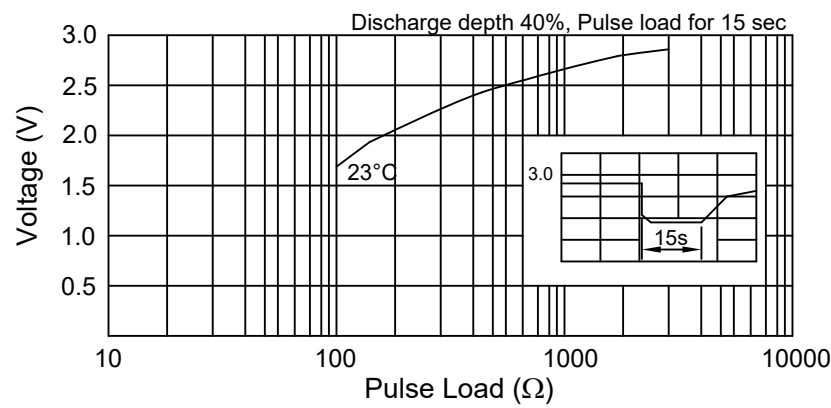


Figure 3. Pules Discharge Characteristics

4.3.4. Temperature Characteristics

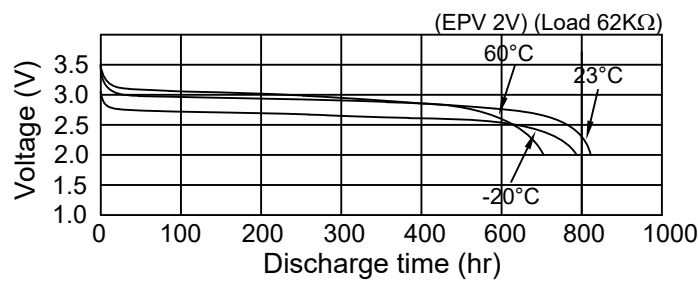


Figure 4. Temperature Characteristics

4.3.5. Load-Capacity

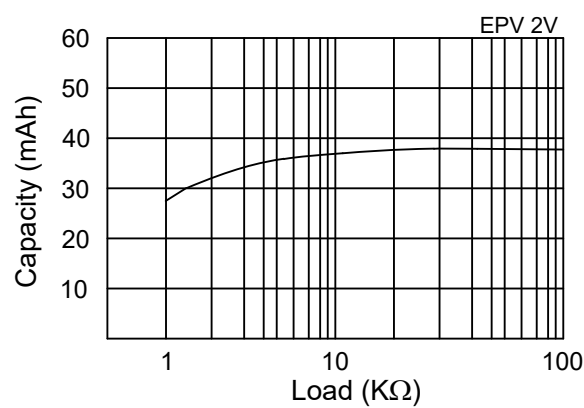


Figure 5. Load-Capacity

4.3.6. Storage Characteristics  
(Storage at 60°C for 30 days equivalent to storage at room temperature for 18 months)

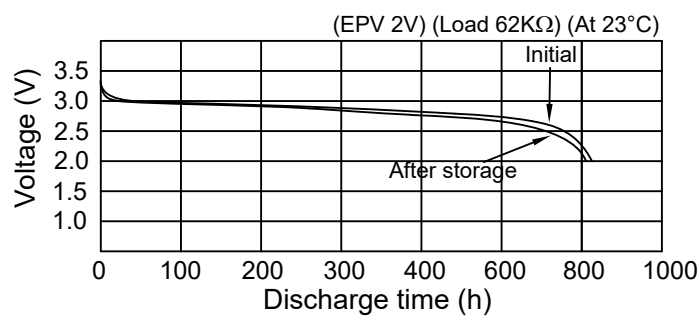


Figure 6. Storage Characteristics

## 5. Reliability Test

- 5.1. Open-circuit Voltage :** Subject samples to  $+20 \pm 2$  °C and  $0 \pm 2$  °C for 8 hours or longer. Then measure the voltage between both terminals at the same ambient temperature with voltmeter.
- 5.2. Short-circuit Voltage :** Subject samples to  $+20 \pm 2$  °C and  $0 \pm 2$  °C for 8 hours or longer. Then measure the voltage between both terminals with voltmeter while the 62K $\Omega$  is connected between both terminals at the same ambient temperature. Measured value shall be based on meter reading taken 8 seconds after the circuit is closed.
- 5.3. Service Life :** Subject samples to  $20 \pm 2$  °C and  $0 \pm 2$  °C for 8 hours or longer. Then continuously discharge at the same ambient temperature and through 62k $\Omega$ . Discharge until terminal voltage of the test specimens falls below the discharge end-point voltage of 2.0V, and the time during which the terminal voltage is equal to and above the discharge end-point voltage shall be taken as the service life.
- 5.4. Service Life after high temperature storage :** Store samples at  $+60 \pm 2$  °C for 20 days. Then subject samples to  $+20 \pm 2$  °C and ordinary humidity  $65\% \pm 20\%$  for 12 hours or longer and continuously discharge through 62K $\Omega$ . Discharge until the voltage falls below the discharge end-point voltage of 2.0V, and the time during which the voltage is equal to and above the discharge end-point voltage shall be taken as the service life.
- 5.5. Electrolyte Leakage Test :** Samples shall be examined for electrolyte leakage while they are kept at  $+20 \pm 2$  °C and ordinary humidity  $75\% \pm 5\%$  after being stored at  $45 \pm 2$  °C and 75% relative humidity for 30 days.
- 5.6. Self-discharge :** Store samples for 12 months at  $+20 \pm 2$  °C and  $65\% \pm 5\%$  relative humidity and tested for service life in accordance with the method specified in 5.3. Self-discharge shall be determined as follows:

$$\text{Self-discharge rate (\%)} = (Y1-Y2)/Y1 \times 100\%$$

Y1 : Average initial discharge life of batteries of the same lot

Y2 : Average discharge life after storage

6. Mechanical Layout

Unit : mm  
Tolerance : Linear    XX.X    = ±0.3  
                             XX.XX    = ±0.05  
                             Angular    = ±0.25°  
(unless otherwise specified)

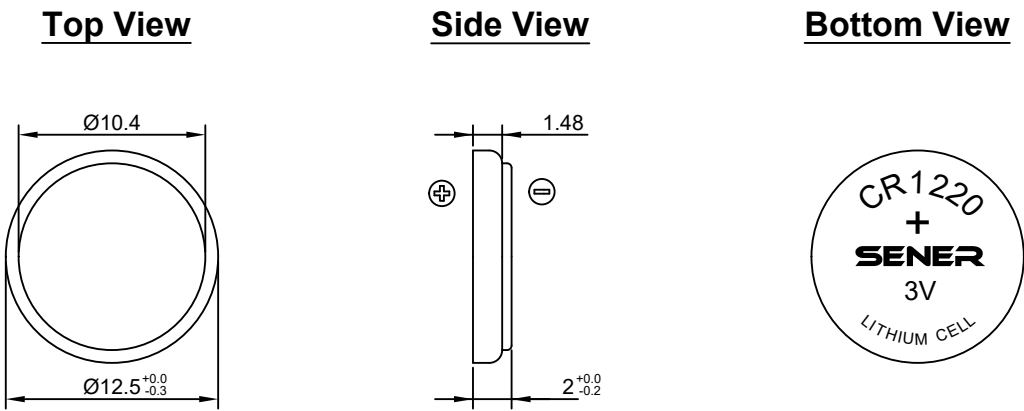


Figure 7. SCR1220 Mechanical Layout